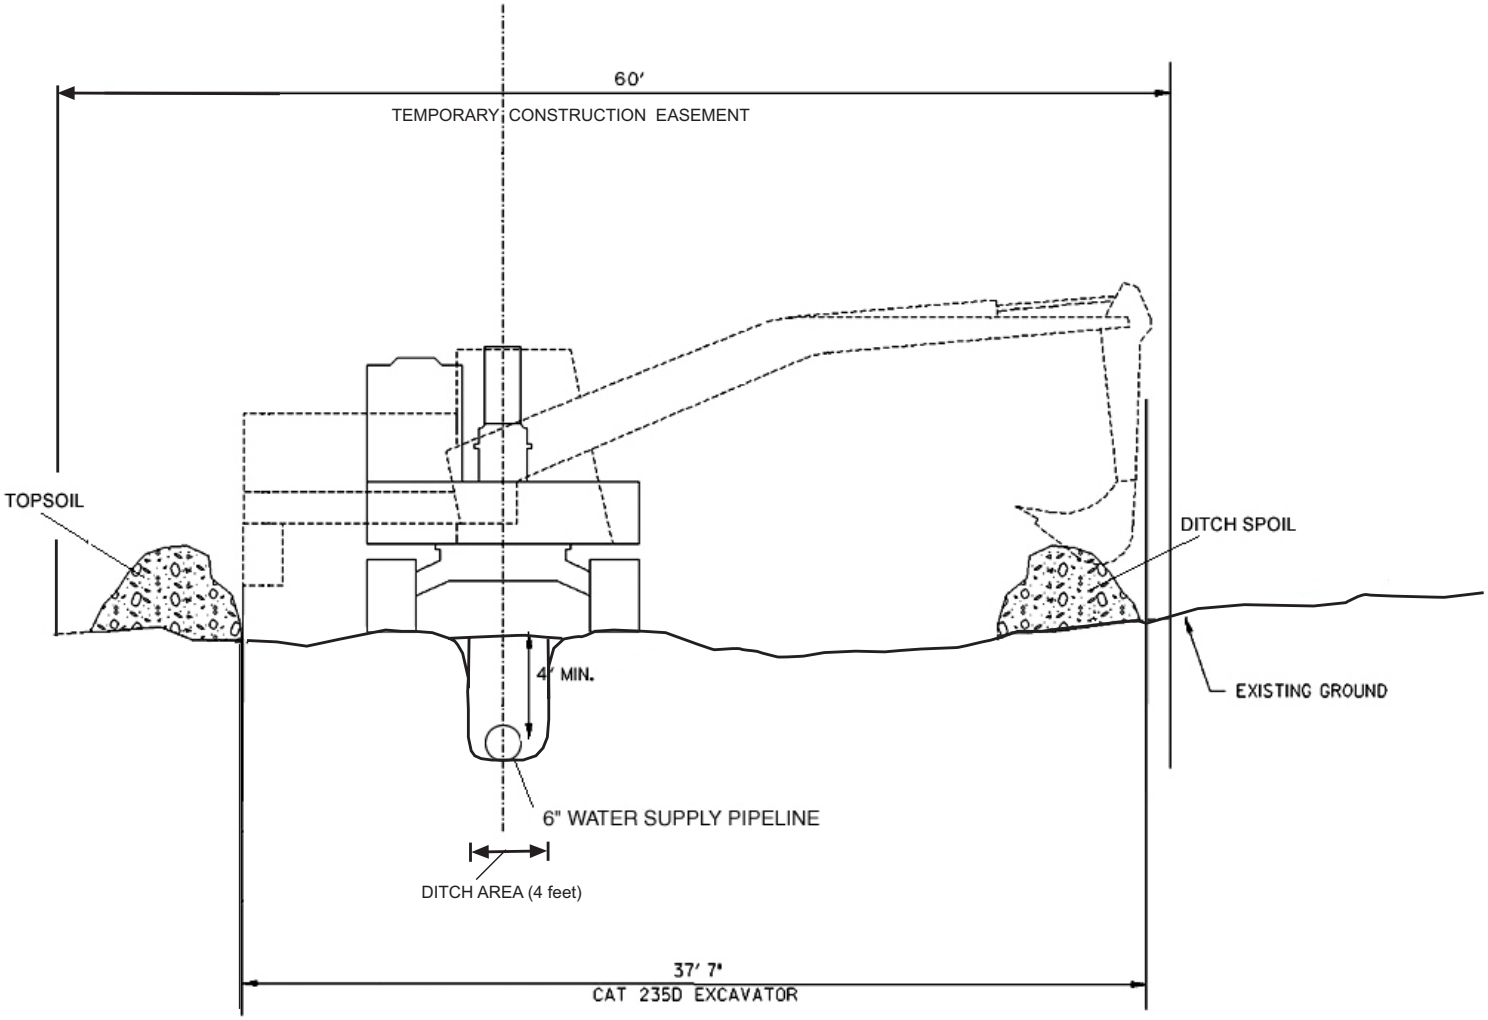

Figure 2-4
Typical Water Supply Pipeline Configuration
COB Energy Facility
Bonanza, OR