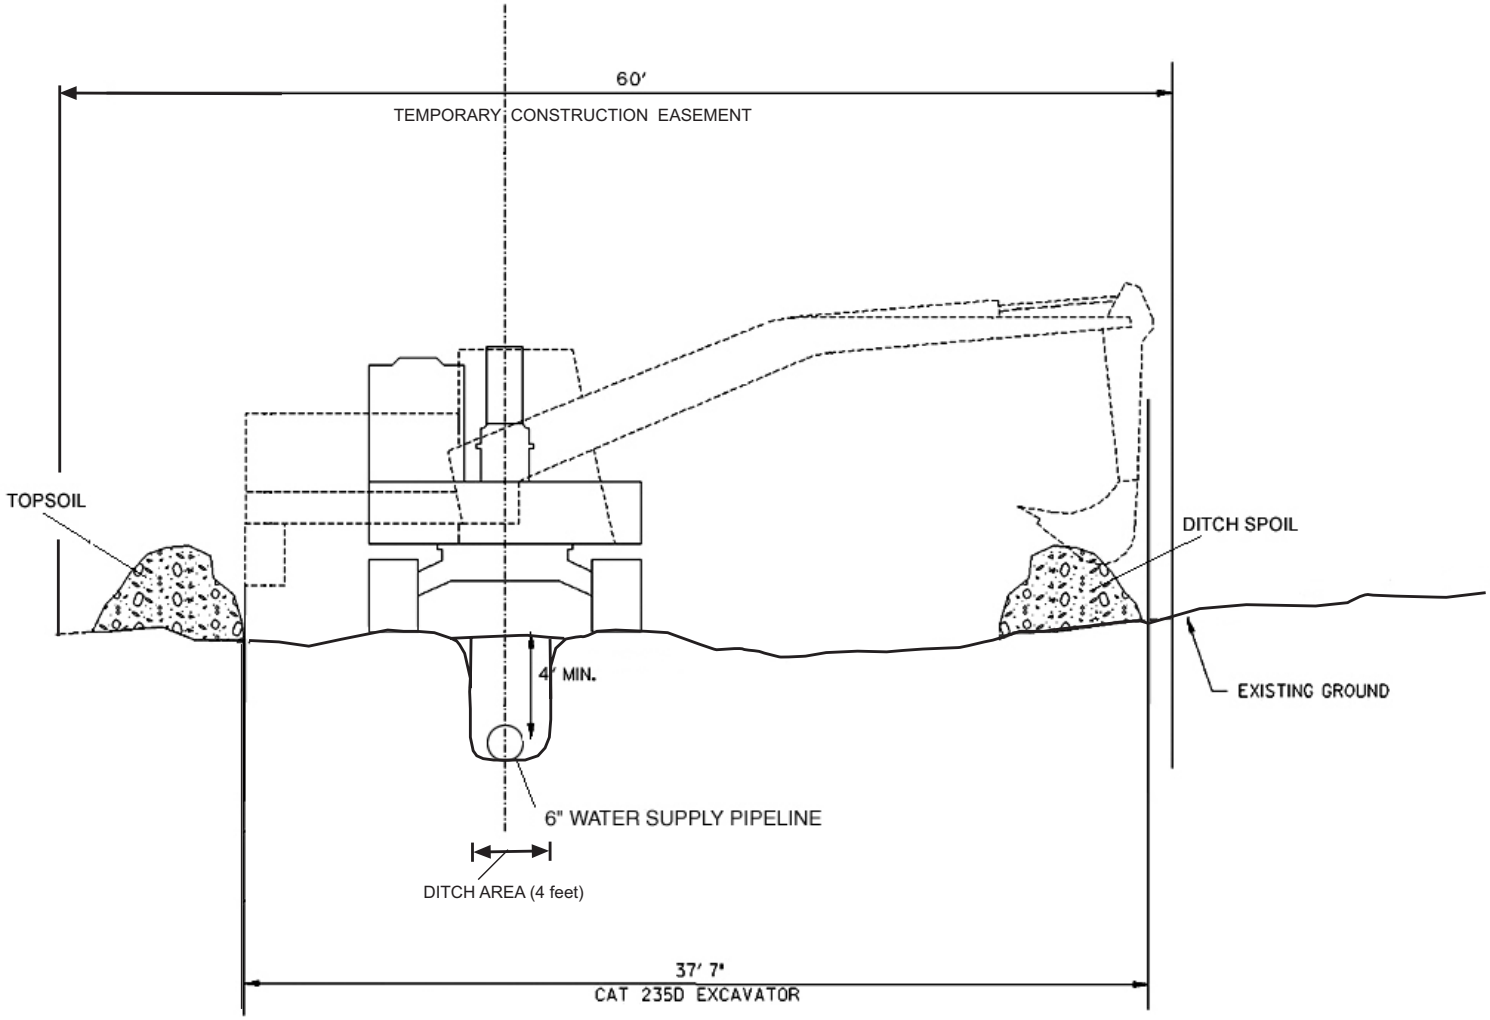

Figure 2-5
Typical Water Supply Pipeline Configuration
Biological Assessment
COB Energy Facility
Bonanza, OR