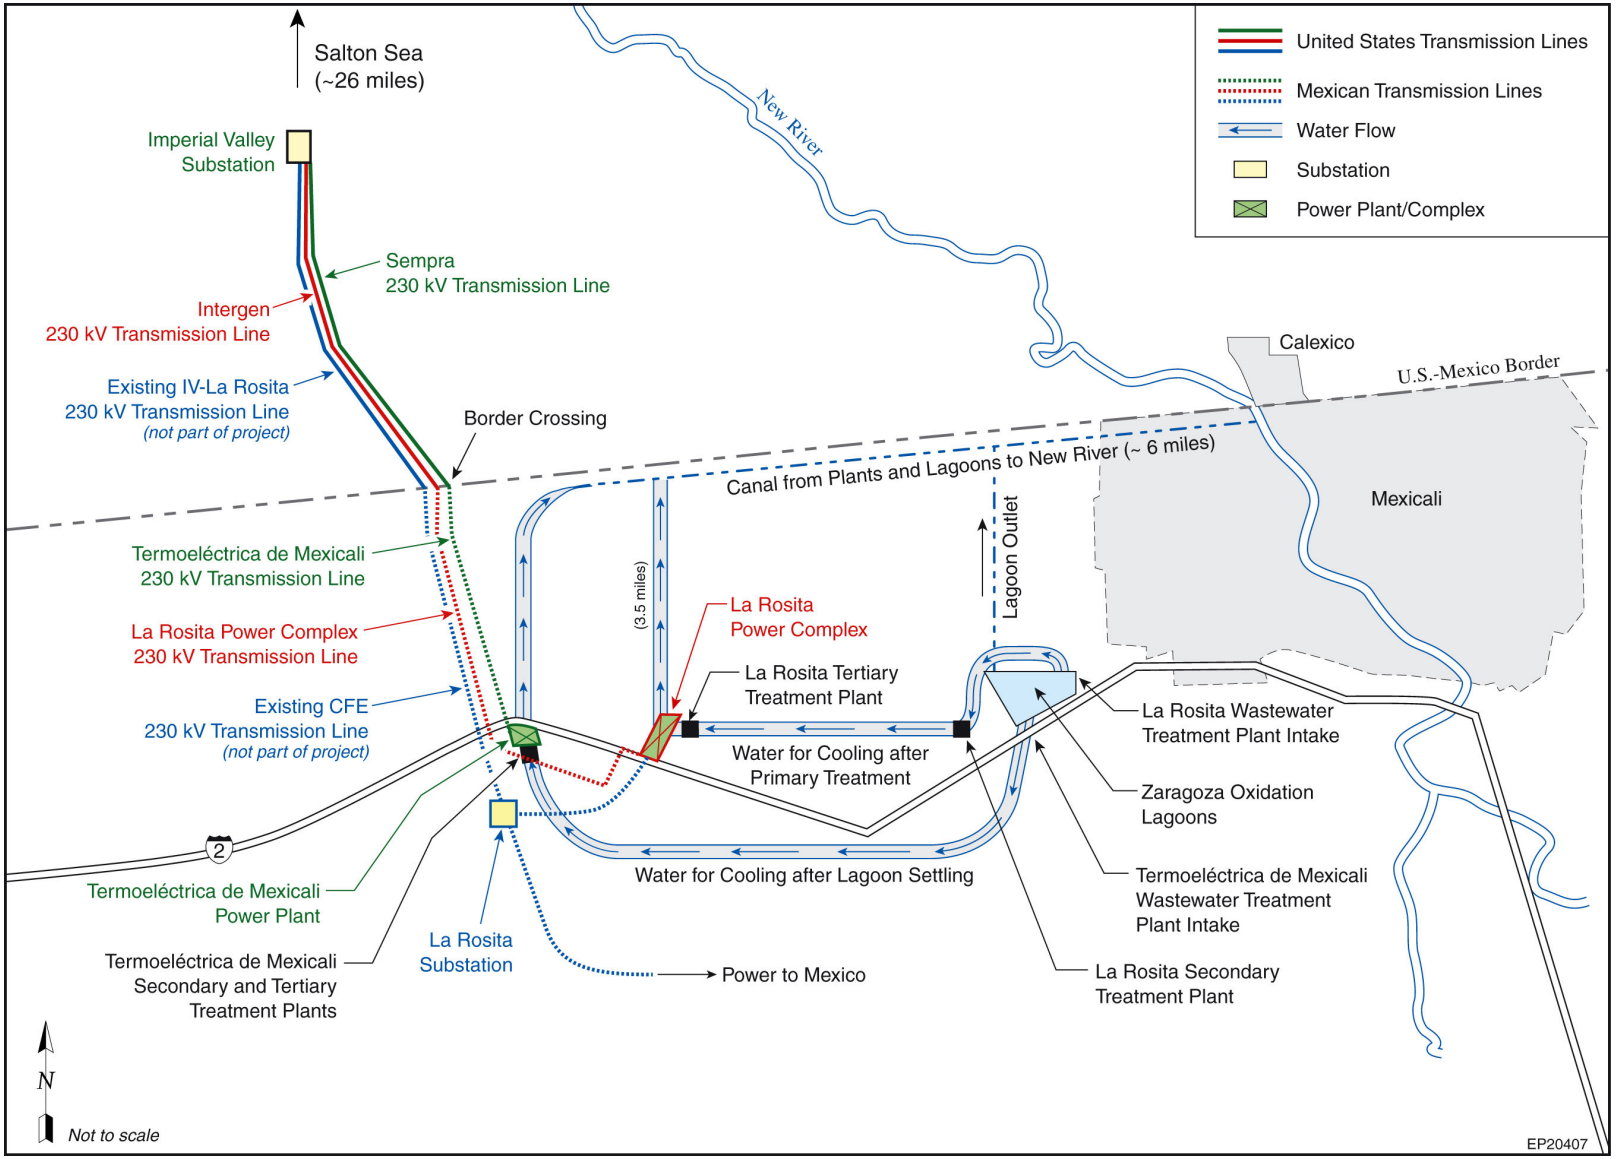

FIGURE S-7 Water Supply Cycle for LRPC and TDM Power Plants